

Diaphragm pressure switch Flameproof enclosure Ex d Model MA

WIKA data sheet PV 31.11



for further approvals
see page 3

Process Performance Series

Applications

- Pressure monitoring and control of processes
- Safety-critical applications in general process instrumentation, especially in the chemical and petrochemical industries, oil and gas industries, power generation incl. nuclear power plants, water/wastewater industries, mining
- For gaseous and liquid, aggressive and highly viscous or contaminated media, also in aggressive ambience

Special features

- No power supply needed for switching of electrical loads
- Robust switch enclosure from aluminium alloy, IP66, NEMA 4X
- Setting ranges from 0 ... 16 mbar to 0 ... 600 bar, vacuum ranges
- Repeatability of the set point $\leq 1\%$ of span
- 1 or 2 independent set points, SPDT or DPDT, high switching power up to AC 250 V, 20 A



Model MA, wall mounting

Description

These high-quality pressure switches have been developed especially for safety-critical applications. The high quality of the products and manufacturing in accordance with ISO 9001 ensure reliable monitoring of your plant. In production, the switches are traced by quality assurance software at every step and subsequently are 100 % tested. All wetted materials are from stainless steel as a standard.

In order to ensure as flexible operation as possible, the pressure switches are fitted with micro switches, which enable the switching of an electrical load of up to AC 250 V, 20 A directly.

For lower switching power ratings, such as for PLC applications, argon gas-filled micro switches with gold-plated contacts can be selected as an option.

For applications with special requirements on the wetted parts, versions with materials from PTFE, Monel or Hastelloy are available.

By using a diaphragm measuring system, the model MA pressure switch is extremely robust and guarantees optimal-operating characteristics.

For setting ranges from 4 ... 40 bar a piston replaces or completes the diaphragm as a measuring element. The wetted parts of this variant from stainless steel are particularly suited for liquid media.

Standard version

Switch enclosure

Aluminium alloy, copper-free, epoxy-resin coated, tamper-proof. Laser-engraved product label from stainless steel

Ingress protection

IP66 per EN/IEC 60529, NEMA 4X

Ignition protection type

Ex d IIC T6/T4 ¹⁾ Ga/Gb (gas)
Ex ta/tb IIIC T85/T135 ¹⁾ Da/Db (dust)

¹⁾ The temperature class is related to the ambient temperature range. See the type examination certificate for further details.

Permissible temperature

Ambient T_{amb} : -40 ... +85 °C
Medium T_M : -30 ... +85 °C

Switch contacts with micro switch

Fixed dead band

- 1 x or 2 x SPDT (single pole double throw)
- 1 x DPDT (double pole double throw)

Adjustable dead band

- 1 x SPDT (single pole double throw)

The DPDT function is realised with 2 simultaneously triggering SPDT micro switches within 0.2 % of the setting range. Information on the dead band can be found on page 4.

Contact version	Electrical rating (resistive load)	
	AC	DC
Fixed dead band		
Silver-plated contact	250 V, 15 A	24 V, 2 A 125 V, 0.5 A 220 V, 0.25 A
Silver-plated contact Filling with argon gas T_{amb} : -30 ... +70 °C	250 V, 15 A	24 V, 2 A 220 V, 0.5 A
Gold-plated contact	125 V, 1 A	24 V, 0.5 A
Gold-plated contact Filling with argon gas T_{amb} : -30 ... +70 °C	125 V, 1 A	24 V, 0.5 A
Adjustable dead band	AC	DC
Silver-plated contact	250 V, 20 A	24 V, 2 A 220 V, 0.5 A

Repeatability of the set point

≤ 1 % of span

Set point adjustment

The set point can be specified by the customer or factory set. Subsequent adjustment of the set point on site is made using the adjustment screw, which is fastened to the switch and thus secured against loss.

Distance between set points

For versions with 2 x SPDT the distance between the set points must be > 5 % of the respective setting range.

Electrical connection

- ½ NPT female (standard)
- ¾ NPT, Gk ½, Gk ¾, M20 x 1.5 female
- Cable gland non-armoured Ex d, nickel-plated brass
- Cable gland non-armoured Ex d, AISI 304
- Cable gland armoured Ex d, nickel-plated brass
- Cable gland armoured Ex d, AISI 304

Cable connection using internal terminal block, protective conductor connection using internal and external screw, max. grounding cable cross-section 4 mm²

Dielectric strength

Safety class I (IEC 61298-2: 2008)

Wetted parts

Setting range 0 ... 16 mbar to 0 ... 40 bar	
Diaphragm element	Process connection
Stainless steel 316 ²⁾	Stainless steel 316L
Stainless steel 316 ²⁾ + PTFE ³⁾	Stainless steel 316L
Stainless steel 316 ²⁾ + PTFE ³⁾	Stainless steel 316L + PTFE (only for G ½ A)
Monel ⁴⁾	Monel
Monel ⁴⁾	Stainless steel 316L

²⁾ Diaphragm element material depending on setting range:
Stainless steel 304: -1 ... 5, 0 ... 6, -1 ... 9, 0 ... 10 bar
Inconel 718: -1 ... 15, 0 ... 16, 0 ... 25, 0 ... 40 bar

³⁾ PTFE coating not available for setting ranges:
-16 ... 0, -25 ... 0, -40 ... 0, 0 ... 16, 0 ... 25, 0 ... 40 mbar, 0 ... 40 bar

⁴⁾ Only for setting ranges ≤ 10 bar

Setting range 4 ... 40 bar to 30 ... 600 bar	
Piston with diaphragm element ⁵⁾	Process connection
Hastelloy C276	Stainless steel 316L
Piston ⁶⁾	Process connection
Stainless steel 316	Stainless steel 316L

⁵⁾ The measuring element is a piston with welded diaphragm element, therefore particularly suited for gaseous media. Extended permissible medium temperature -40 ... +85 °C

⁶⁾ The measuring element is a piston, therefore particularly suited for liquid media. Limited permissible medium temperature -10 ... +85 °C for sealing material NBR or 0 ... 85 °C for sealing material FPM.
Ignition protection type is: Ex d II C T6/T4 Gb and Ex tb III C T85/T135 Db

Sealing

PTFE, FPM, NBR, without sealing: Welded diaphragm element, depending on setting range and operating conditions

Process connection

Stainless steel, lower mount (LM)

- ¼ NPT female (standard)
- ½ NPT, G ½ A, G ¼ A male via adapter
- ½ NPT, G ¼ female via adapter
- Flange connection

Mounting

Direct or wall mounting

- Mounting fixture from stainless steel (AISI 304)
- Option: Mounting bracket for 2" pipe mounting

For mounting positions see drawing on page 5.

Weight

approx. 3.1 ... 3.5 kg, depending on setting range

Options

- Cleaned for oxygen service
- Protection from stainless steel 316L or Hastelloy for setting ranges 2.5 bar up to 25 bar
- Sealing towards the pressure chamber PTFE/NBR
- Permissible ambient temperature to -60 °C, not available for argon gas-filled contacts
- Offshore version with increased corrosion protection ¹⁾
- NACE version ¹⁾

1) WIKA recommends argon gas-filled contact versions. The use of switch contacts with adjustable dead band is allowed.

Please specify

Set point, switching direction for each contact, e.g.

- set point 1: 0.5 bar, falling
- set point 2: 3 bar, rising

With two micro switches, the set points can be adjusted independently of each other.

After unscrewing the cover, **set point adjustment** can be made using the adjustment screw. The set point is selectable within the entire setting range.

For optimal performance we suggest to adjust the set point between 25 % and 75 % of the setting range.

Example






Setting range: 0 ... 1 bar with one switch contact

Repeatability: 1 % of 1 bar = 10 mbar

Dead band = 15 mbar (see table setting ranges)

If the pressure is rising, the set point should be adjusted between 35 mbar and 1 bar. If the pressure is falling, the set point should be adjusted between 0 and 965 mbar


Approvals

Logo	Description	Country
	EU declaration of conformity <ul style="list-style-type: none"> ■ Pressure equipment directive PED, annex 1, category IV, safety accessories, module B + D ■ ATEX ²⁾ directive; annex III, IV 1/2 GD (Versions MAB, MA, MAG) 2 GD (Version MAH) 	European Community
	IECEx ²⁾ , per IEC 60079-0, IEC 60079-1, IEC 60079-31, IEC 60079-26 Ex d IIC T6/T4 ³⁾ Ga/Gb, Ex ta/tb IIIC T85/T135 ³⁾ Da/Db (Versions MAB, MA, MAG) Ex d IIC T6/T4 ³⁾ Gb, Ex ta/tb IIIC T85/T135 ³⁾ Db (Version MAH)	IECEx member states
	EAC (option) Hazardous areas	Eurasian Economic Community
	INMETRO (option) Hazardous areas (option)	Brazil
	KOSHA (option) Hazardous areas	South Korea

2) Double marking ATEX and IECEx on the same product label.

3) The temperature class is related to the ambient temperature range.

Manufacturer's information and certifications

Logo	Description
	SIL 2 rating (option) , per IEC 61508 Functional safety The electrical rating for DC applications is limited to 30 V ... 100 mA.
	Conformity per EN 12952-11 and EN 12953-9 Standards for limiting devices in water-tube boiler and shell boiler applications
	Conformity per EN 1854 Pressure sensing devices for gas burners and gas burning appliances

Certificates (option)

- 2.2 test report per EN 10204
- 3.1 inspection certificate per EN 10204

Approvals and certificates, see website

Measuring element: Diaphragm (versions MAB, MA)

Version MAB: Span 16 mbar to max. 100 mbar

Standard		Option 1		Option 2		Dead band		
Setting range (=working range)	Proof pressure	Working range	Proof pressure	Working range	Proof pressure	1 contact, fixed	2 contacts, fixed	1 contact, adjustable
in mbar		in bar	in bar	in bar	in bar	in mbar	in mbar	in mbar
0 ... 16	250	0 ... 8	10	-1 ... 8 ¹⁾	10	≤ 2.0	≤ 2.8	-
0 ... 25	250	0 ... 8	10	-1 ... 8 ¹⁾	10	≤ 2.0	≤ 3	8 ... 18
0 ... 40	300	0 ... 8	10	-1 ... 8 ¹⁾	10	≤ 2.6	≤ 3.4	8 ... 20
0 ... 60	300	0 ... 8	10	-1 ... 8 ¹⁾	10	≤ 3.0	≤ 4.2	12 ... 25
0 ... 100	600	0 ... 8	10	-1 ... 8 ¹⁾	10	≤ 3.6	≤ 5	17 ... 40
-16 ... 0	-21	-1 ... 0 ¹⁾	0.25	-	-	≤ 2.0	≤ 2.8	-
-25 ... 0	-35	-1 ... 0 ¹⁾	0.25	-	-	≤ 2.0	≤ 3	8 ... 18
-40 ... 0	-55	-1 ... 0 ¹⁾	0.30	-	-	≤ 2.6	≤ 3.4	8 ... 20
-60 ... 0	-90	-1 ... 0 ¹⁾	0.30	-	-	≤ 3.0	≤ 4.2	12 ... 25
-100 ... 0	-150	-1 ... 0 ¹⁾	0.40	-	-	≤ 3.6	≤ 5	17 ... 40
-12.5 ... +12.5	-25 / 250	-	-	-	-	≤ 2.0	≤ 3	8 ... 18
-30 ... +30	-60 / 250	-	-	-	-	≤ 3.0	≤ 4.2	12 ... 25
-50 ... +50	-100 / 250	-	-	-	-	≤ 3.6	≤ 5	17 ... 40

Version MA: Span 0.2 bar to max. 40 bar

Standard		Option 1		Option 2		Dead band		
Setting range (=working range)	Proof pressure	Working range	Proof pressure	Working range	Proof pressure	1 contact, fixed	2 contacts, fixed	1 contact, adjustable
in bar		in bar	in bar	in bar	in bar	in mbar	in mbar	in mbar
0 ... 0.2	6	0...32	40	-1 ... 32 ¹⁾	40	≤ 10	≤ 13	30...70
0 ... 0.4	10	0...32	40	-1 ... 32 ¹⁾	40	≤ 15	≤ 20	40 ... 95
-0.2 ... 0	-0.3	-1...0 ¹⁾	-1	-1 ... 8	10	≤ 10	≤ 13	30 ... 70
-0.4 ... 0	-0.6	-1...0 ¹⁾	-1	-1 ... 8	10	≤ 15	≤ 20	40 ... 95
-0.1 ... +0.1	-0.2 / 1	-	-	-	-	≤ 10	≤ 13	30 ... 70
-0.5 ... 0.5	-1 / 4	-	-	-	-	≤ 15	≤ 50	75 ... 170
-1 ... 0	-1	-1 ... 8	10	-	-	≤ 15	≤ 50	75 ... 170
-1 ... 1.5	2	-1 ... 8	10	-	-	≤ 48	≤ 67	200 ... 500
-1 ... 5	60	-1 ... 80	100	-	-	≤ 100	≤ 160	400 ... 1,000
-1 ... 9	60	-1 ... 80	100	-	-	≤ 100	≤ 180	600 ... 1,400
-1 ... 15	60	-1 ... 80	100	-	-	≤ 150	≤ 250	1,000 ... 2,400
0 ... 1	25	0 ... 32	40	-1 ... 32	40	≤ 15	≤ 50	75 ... 170
0 ... 1.2	25	0 ... 32	40	-1 ... 32	40	≤ 15	≤ 50	75 ... 170
0 ... 2.5	60	0 ... 80	100	-1 ... 80	100 ²⁾	≤ 48	≤ 67	200 ... 500
0 ... 6	60	-1 ... 80	100	-	-	≤ 100	≤ 160	400 ... 1,000
0 ... 10	60	-1 ... 80	100	-	-	≤ 100	≤ 180	600 ... 1,400
0 ... 16	60	-1 ... 80	100	-	-	≤ 150	≤ 250	1,000 ... 2,400
0 ... 25	60	-1 ... 80	100	-	-	≤ 300	≤ 450	1,700 ... 4,000
0 ... 40	60	-	-	-	-	≤ 400	≤ 800	2,200 ... 5,800

1) Option diaphragm element with PTFE not available

2) Proof pressure of 100 bar not available for wetted parts from PTFE and Monel

Measuring element: Piston with diaphragm (version MAG), piston only (version MAH)


Versions MAH, MAG: Span 36 bar to max. 570 bar

Standard			Dead band		
Setting range	Working range	Proof pressure	1 contact, fixed	2 contacts, fixed	1 contact, adjustable ³⁾
in bar			in bar	in bar	in bar
4 ... 40	0 ... 40	100	≤ 3	≤ 4	5 ... 11 to 8 ... 15
10 ... 100	0 ... 100	200	≤ 4	≤ 6	10 ... 22 to 15 ... 28
10 ... 250	0 ... 250	400	≤ 10	≤ 13	15 ... 38 to 27 ... 55
20 ... 400	0 ... 400	600	≤ 10	≤ 25	35 ... 80 to 43 ... 90
30 ... 600	0 ... 600	700	≤ 20	≤ 25	45 ... 105 to 83 ... 155


3) The adjustable dead band depends on the set point adjustment. The indicated ranges are valid for start and end of the setting range. Other setting ranges are proportional.

Dimensions in mm


Version MAB

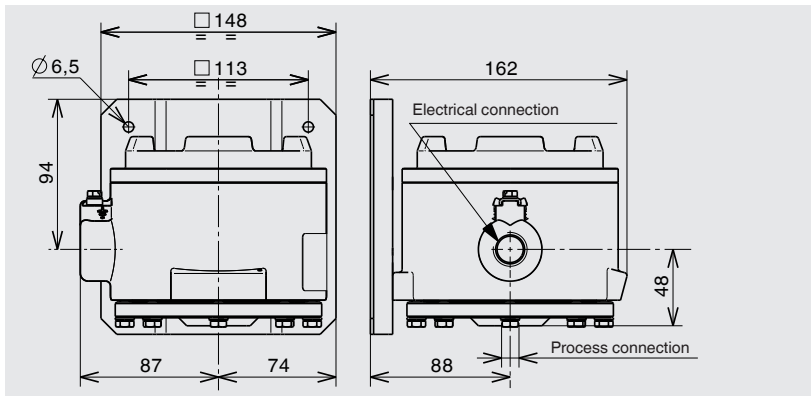

Versions MA, MAH, MAG

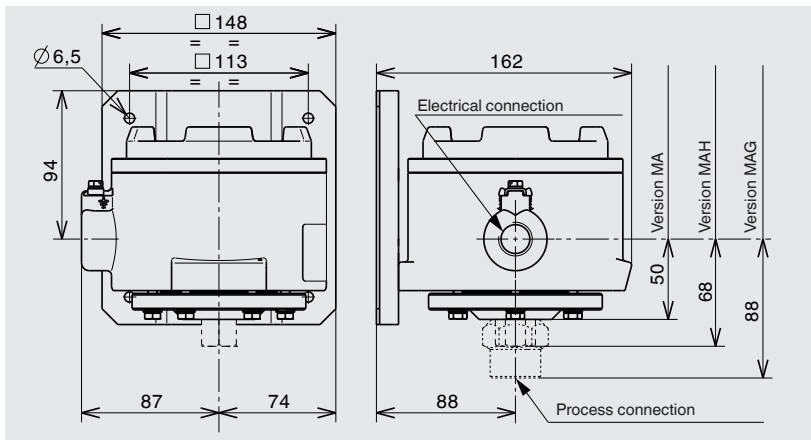

Mounting positions

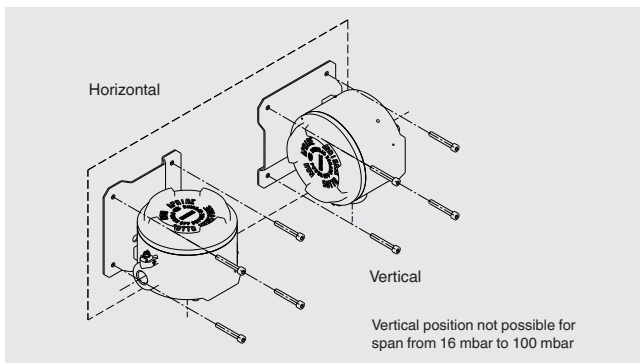

Ordering information

Model / Unit / Setting range of set point / Number of switches / Contact version / Process connection / Electrical connection / Wetted parts / Options

© 2009 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.



Diaphragm pressure switch, flameproof enclosure Ex d

07/2016

Applications

- Pressure monitoring and control of processes
- Safety-critical applications in general process instrumentation, especially in the chemical and petrochemical industries, oil and gas industries, power generation incl. nuclear power plants, water/wastewater industries, mining
- For gaseous and liquid, aggressive and highly viscous or contaminated media, also in aggressive ambience

Special features

- No power supply needed for switching of electrical loads
- Robust switch enclosure from aluminium alloy, IP 66, NEMA 4X
- Setting ranges from 0 ... 16 mbar to 30 ... 600 bar, vacuum ranges
- Repeatability of the set point $\leq 1\%$ of span
- 1 or 2 independent set points, SPDT or DPDT, high switching power up to AC 250 V, 20 A



Order numbers

Measuring elements and wetted materials	XX - Diaphragm AISI 316, 304, Inconel or Hastelloy (piston AISI 316), process connection AISI 316L	
Contact versions	UN - 1x SPDT silver contact	US - 1x SPDT silver contact, hermetically sealed, argon gas filling
Process connection	1/4 NPT-F	
Electrical connection	1/2 NPT-F	
Setting range		
0 ... 16 mbar	14183015	14183016
0 ... 100 mbar	14183018	14183019
0 ... 1 bar	14183021	14183022
0 ... 6 bar	14183024	14183025
0 ... 25 bar	14183026	14183027
10 ... 250 bar ¹⁾	14183028	14183029
30 ... 600 bar ¹⁾	14183030	14183031

¹⁾ Sensor: welded diaphragm (MAG)

Legend: available from stock in Germany available after production ---- not available

Quick order code (for further details see data sheet PV 31.11)

Field no.	Code	Version				
Model						
①	MAB	low setting ranges from -100 ... 0 mbar up to 0 ... 100 mbar				
	MA-	medium setting ranges from -1 ... 0 bar up to 0 ... 40 bar				
	MAG	high setting ranges from 4 ... 40 bar up to 30 ... 600 bar, sensor welded diaphragm				
	MAH	high setting ranges from 4 ... 40 bar up to 30 ... 600 bar, sensor piston				
Measuring elements and wetted materials						
②	XX	Diaphragm AISI 316, 304, Inconel or Hastelloy (Piston AISI 316)/ Process Connection AISI 316L				
	TX	Diaphragm + PTFE coating / Process Connection AISI 316L				
	TT	Diaphragm + PTFE coating / Process Connection AISI 316L + PTFE				
	KK	Diaphragm Monel / Process Connection Monel				
	KX	Diaphragm Monel / Process Connection AISI 316L				
Contact versions						
③	UN	1x SPDT silver contact				
	US	1x SPDT silver contact, hermetically sealed, argon gas filling				
	UO	1x SPDT gold-plated contact, hermetically sealed, argon gas filling				
	UG	1x SPDT gold-plated contact				
	UR	1x SPDT silver contact, adjustable dead band				
	DN	2 x SPDT or 1 x DPDT silver contact				
	DS	2 x SPDT or 1 x DPDT silver contact, hermetically sealed, argon gas filling				
	DO	2 x SPDT or 1 x DPDT gold-plated contact, hermetically sealed, argon gas filling				
	DG	2 x SPDT or 1 x DPDT gold-plated contact				
Setting range						
④	MNF	-16...0 mbar	MAJ	0...100 mbar	BBD	0...1 bar
	MNG	-25...0 mbar	MNK	-200...0 mbar	BBE	0...1,2 bar
	MNH	-40...0 mbar	MNM	-400...0 mbar	BBG	0...2,5 bar
	MNI	-60...0 mbar	MCD	-100...100 mbar	BBI	0...6 bar
	MNJ	-100...0 mbar	MCF	-500...500 mbar	BBJ	0...10 bar
	MCA	-12,5...12,5 mbar	MAL	0...200 mbar	BBK	0...16 bar
	MCB	-30...30 mbar	MAN	0...400 mbar	BBL	0...25 bar
	MCC	-50...50 mbar	BMD	-1...0 bar	BBM	0...40 bar
	MAF	0...16 mbar	BME	-1...1,5 bar	BBN	4...40 bar
	MAG	0...25 mbar	BMF	-1...5 bar	BBQ	10...100 bar
	MAH	0...40 mbar	BMG	-1...9 bar	BBS	10...250 bar
	MAI	0...60 mbar	BMH	-1...15 bar	BBV	20...400 bar
					BBX	30...600 bar
	Working range (please have a look on further details, shown on Datasheet PV 31.11)					
	⑤	S	Standard			
		1	Option 1			
2		Option 2				
Special design features						
⑥	O	cleaning for oxygen service				
	N	NACE				
	Z	without				
Ambient / application condition						
⑦	D1	suitable for ambient temperature up to -60°C				
	O1	Offshore				
	ZZ	without				

Order code: ① ② ③ - ④ ⑤ **B-1AMZ** ⑥ ⑦

Please specify approvals and certificates via free text.

C5 Flameproof Ex d IECEx-ATEX
C4 SIL 2 for functional safety

© 2016 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.

DIAPHRAGM PRESSURE SWITCHES

WEATHERPROOF AND INTRINSICALLY SAFE: MODEL MW	FLAMEPROOF: MODEL MA
Versions: MWB-MW-MWH-MWG	Versions: MAB-MA-MAH-MAG
<p>A = pressure attachment B = cable entry</p>	<p>A = pressure attachment B = cable entry</p>
For surface mounting use two screws M6	For surface mounting use four screws M6
WEIGHT 1,8 kg Dimensions in mm	WEIGHT 3,2 kg Dimensions in mm

NOTE: dimensions and weights are not binding unless released on certified drawings.

CAUTION

- Before installing, using or carrying out maintenance on the instrument it is necessary to **read** and **understand** the indications given in the attached Instruction Manual.
- The instrument must only be installed and maintained by **qualified personnel**.
- **INSTALLATION IS TO BE CARRIED OUT ONLY AFTER CHECKING THAT INSTRUMENT CHARACTERISTICS ARE CONSISTENT WITH PROCESS AND PLANT REQUIREMENTS.**
- The functional **features** of the instrument and its degree of protection are shown on the identification plate fixed to the case.



CONTENTS:

- 1 GENERAL NOTES
- 2 OPERATING PRINCIPLE
- 3 MODEL CODE
- 4 IDENTIFICATION PLATE AND MARKINGS
- 5 SET POINT REGULATION
- 6 SET POINT CALIBRATION
- 7 MOUNTING AND CONNECTIONS
- 8 INSTRUMENT PLUMBING
- 9 SAFETY INTEGRITY LEVEL (SIL) INSTALLATION REQUIREMENTS
- 10 PUTTING INTO OPERATION
- 11 VISUAL INSPECTION
- 12 FUNCTIONAL VERIFICATION
- 13 STOPPING AND DISMOUNTING
- 14 DISPOSAL
- 15 TROUBLESHOOTING

RELATED DOCUMENT
To authenticated document with certificate
N° IECEx PRE 16.0067X
N° IECEx PRE 16.0074X



SAFETY INSTRUCTIONS FOR USE IN HAZARDOUS ATMOSPHERES.



RECOMMENDATIONS FOR PRESSURE SWITCH SAFE USE.

All data, statements and recommendations supplied with this manual are based on information believed by us to be reliable. As the conditions of effective use are beyond our control, our products are sold under the condition that the user himself evaluates such conditions before following our recommendations for the purpose or use foreseen by him.

The present document is the property of ALEXANDER WIEGAND SE & Co and may not be reproduced in any form, nor used for any purpose other than that for which it is supplied.

1 GENERAL NOTES

1.1 FOREWORD

The wrong choice of a model/ version, as well as the incorrect installation, lead to malfunction and reduce instrument life. Failure to abide by the indications given in this manual can cause damage to the instrument, the environment and persons.

1.2 ALLOWED OVERRANGE

Pressure exceeding the working range can be **occasionally** tolerated provided they remain within the limits stated in the instrument features (vacuum or proof pressure). **Continuous** pressures exceeding the working range can be applied to the instrument provided they are clearly stated in the instrument features. The current and voltage values stated in the technical specifications and ratings must **not** be exceeded. Transitory overages can have a destructive effect on the switch.

1.3 MECHANICAL VIBRATION

Can generally lead to the wearing of some parts of the instrument or cause spurious action. It is therefore recommended that the instrument be installed in a place where there are no vibrations. In cases where this is impossible it is a good idea to take measures to lessen the effects (elastic supports, installation with the switch plunger of the microswitch positioned at right angles to the vibration plane).

1.4 TEMPERATURE

Due to the temperature of both the environment and the process fluid, the temperature of the instrument could exceed the allowed limits (normally from -40° to +60°C). Therefore, in case it does, suitable measures (protection against heat radiation, fluid separators, cooling coils, heated lockers) must be taken. The process fluid or its impurities must not however solidify in the instrument.

2 OPERATING PRINCIPLE

The pressure, acting on the sensitive element (diaphragm), determines its elastic deformation which is used to activate one or two electric microswitches regulated at set point values. The microswitches are of the rapid release type with automatic rearm. When the pressure moves away from the set values, returning towards the normal values, the switch is rearmed. The dead band (gap between the set point value and the reset value) can be fixed or adjustable (letter R in the contact codes).

The versions with sensing element H or G are piston activated diaphragm instruments. The pressure, acting on a piston element, generates a force which, applied to the diaphragm, causes an elastic deformation.


3 MODEL CODE

See Annex 1

4 IDENTIFICATION PLATE AND MARKINGS

The instrument is fitted with a metal plate bearing all its functional characteristics and in case of flameproof or intrinsic safety execution also the markings prescribed by standard IEC/EN 60079-0. Fig. 1 shows the plate mounted on flameproof instruments.

Fig. 1 - Flameproof instruments plate

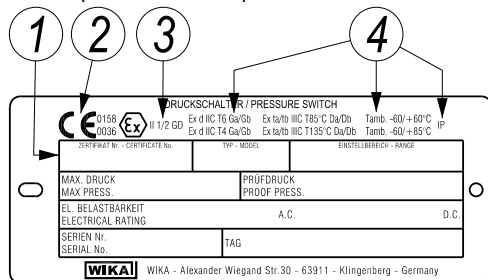

- 1 Notified body that issued the type certificate and number of said certificate.
- 2 CE marking and identification number of the notified body responsible for production surveillance.
- 3 Apparatus classification according to ATEX 2014/34/EU directive.
- 4 Type of protection and ambient temperature limits of operation.

The following table gives the relationship between hazardous areas, ATEX Categories and Equipment Protection Level (EPL) listed on the flameproof instrument nameplate

Hazardous area		Categories according to 2014/34/EU Directive (ATEX)	EPL
Gas, vapours, fog	Zone 0	1G	Ga
Gas, vapours, fog	Zone 1	2G or 1G	Gb or Ga
Gas, vapours, fog	Zone 2	3G, 2G or 1G	Gc, Gb or Ga
Dust	Zone 20	1D	Da
Dust	Zone 21	2D or 1D	Db or Da
Dust	Zone 22	3D, 2D or 1D	Dc, Db or Da


5 SET POINT REGULATION

Each microswitch is independent and can be adjusted by means of a screw (for adjustment) to snap when the pressure reaches (increasing or decreasing) the desired value (set point). The instrument is usually supplied with the switches adjusted at the setting range value nearest to zero (**factory calibration**). The instrument is supplied with a label showing the set point calibration value. With **factory calibration** the values are not indicated, as these are temporary and will be modified with the definitive values. Prior to installation the instrument must be **calibrated** and the definitive calibration values written on the label.

If the instrument has been ordered with a **specific calibration**, check the calibration values marked on the relevant label, prior to installation.



The position of the adjustment screw is given in figure 2.

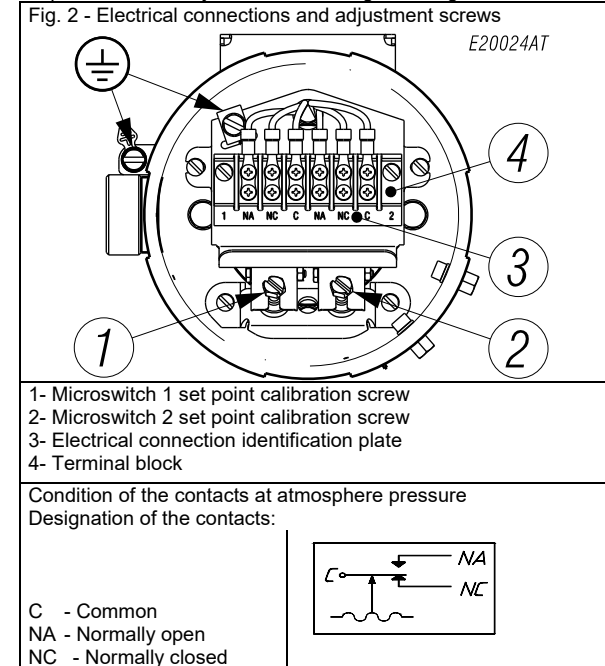


The effect that the direction of rotation of the adjustment screw has is described on the label.

6 SET POINT CALIBRATION

In order to proceed with the calibration and the periodical functional verification of the instrument a suitable **calibration circuit** (Fig. 3) and an adequate pressure source is required. The test instrument should have a measurement range approximately equal to or slightly wider than the pressure switch range and should have an accuracy consistent with the accuracy required to calibrate the set point.

Fig. 3 - Calibration circuit

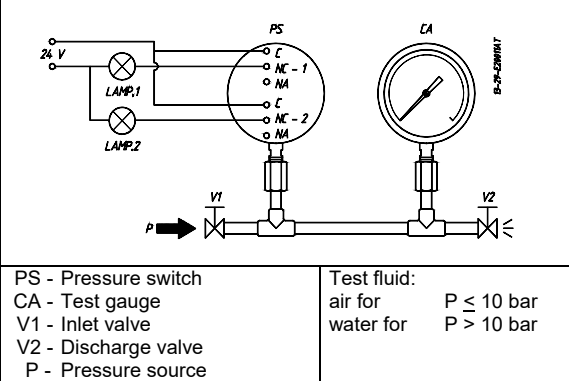


6.1 PRELIMINARY OPERATIONS

6.1.1 Weatherproof pressure switches (Model MW)

Remove the blocking device fixed to the side of the instrument case (Fig. 4). Remove the cover by rotating it in an anticlockwise direction.

Fig. 4 - Weatherproof pressure switch blocking device

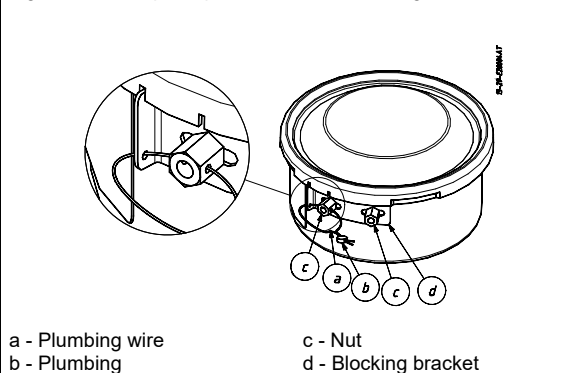


6.1.2 Flameproof pressure switches (Model MA)

CAUTION: do not open the cover of pressure switches when energized, in explosive atmospheres.

Loosen the locking headless screw situated on the cover using a 1,5 hexagonal key then unscrew the cover (fig.5).

Fig. 5 - Flameproof pressure switch blocking device

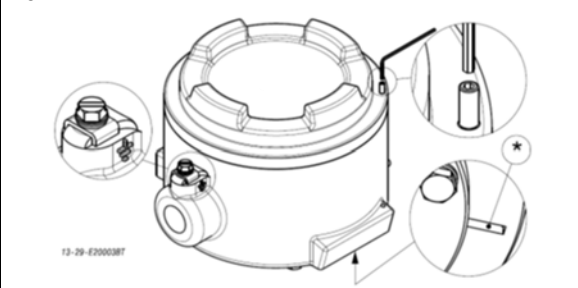

6.2 CALIBRATION CIRCUIT AND OPERATIONS

Prepare the calibration circuit as indicated in Fig.3. The warning lamps should be connected to contact 1 or 2 in the NO or NC position according to the required contact action.

Connection of C and NO terminals

• If the circuit is open at the working pressure, the switch **closes** the circuit as the pressure **increases** when the desired value is reached.

• If the circuit is closed at the working pressure, the switch **opens** the circuit as the pressure **decreases** when the desired value is reached.

Connection of C and NC terminals

• If the circuit is closed at the working pressure, the switch **opens** the circuit as the pressure **increases** when the desired value is reached.

• If the circuit is open at the working pressure, the switch **closes** the circuit as the pressure **decreases** when the desired value is reached.

The pressure switch must be mounted in the normal installation position, i.e. with the pressure connection pointing downwards. Avoid forcing the elastic support of the microswitch by hand or with tools. This could affect the instrument functioning.

CAUTION: if the switch is of the kind with adjustable dead band (letter R in the contact codes) before proceeding with the following operations it is necessary to proceed with the adjustment of the dead band.

Increase the pressure in the circuit up to the desired set point value for the first microswitch. Use a wide bladed screwdriver, as indicated on the label, turn the screw until the relative lamp turns on (or turns off).

- If the instrument is equipped with only **one contact** the calibration is complete.

- If it is equipped with **two contacts** continue in the following manner. Vary the pressure until the desired set point value for the second microswitch is reached. Act on the adjustment screw of the second contact.

Repeat calibrating operations on the first contact, then on the second contact, until the required set point accuracy is obtained. This is necessary due to the reciprocal influence which the microswitches have on the sensitive element of the instrument.

CAUTION: if the two set point are different they must be different for much of 5% of the adjustable span.

6.3 CALIBRATION OF INSTRUMENT WITH SENSING ELEMENT H AND G

The pressure switches equipped with sensor H and G, are instruments with a piston sensing element. To perform an high accuracy calibration, due to the sensing element, it is necessary to adjust the set point by varying the pressure from the normal working pressure of operation to the set point.

6.4 CHECK OF SET POINT

Generate the normal working pressure and wait the pressure stabilisation. Vary the pressure into the circuit and record the set point value. Write the set point values on the adhesive label.


Note: the repeatability should be checked verifying for three times the set point (Pi) starting always from the same pressure value (Pw). The pressure cycle should be slowly to give the possibility to record the set point with accuracy.

6.5 ADJUSTMENT OF DEAD BAND (LETTER R ON THE MODEL CODE)

The dead band can be adjusted only on the instrument is equipped with a microswitch, which allows adjusting (Letter R on the model code). Adjustment may be obtained by rotating the wheel placed on the microswitch (Fig. 6).

In order to carry out this operation it is advisable to insert thumb and forefinger of the left hand in the instrument. The instrument is normally delivered adjusted on the **minimum value** of its range (factory calibration).

Fig. 6 - Adjustment of dead band

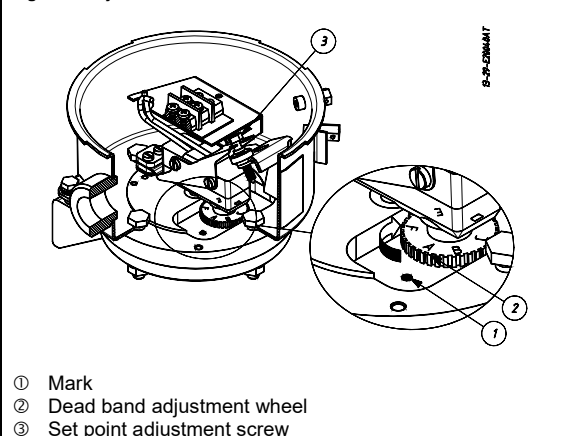

6.5.1 Calibration of dead band

The calibration of the dead band is obtained using the following procedure:

- 1 - Raise pressure in the circuit until reaching the set point and record its value (Pi).
- 2 - Reduce pressure in the circuit until reaching the reset point and record its value (Pr).
- 3 - The difference $P_i - P_r = V_a$ represents the dead band factory adjusted value.
- 4 - Rotate the adjustment wheel in the sense shown in Fig. 6 placing letter B on the mark.
- 5 - Repeat operations 1 and 2 and measure the new dead band V_b .
- 6 - By comparing the values V_a and V_b approximately determine the letter of the wheel to be placed on the mark.
- 7 - Place the mark and measure the obtained dead band.
- 8 - Proceed by successive approximations until reaching the desired dead band value with enough accuracy.
- 9 - Then proceed with the set point calibration

Example: The dead band increase corresponding to the rotation from A to B is given by: $V_b - V_a = \Delta$

The desired dead band V will be approximately in the position indicated by the value $K = V / \Delta$ which expresses:

- By units, the letters of the wheel (1=A, 2=B, 3=C, 4=D, 5=E, 6=F)
- By decimal digits, the percentage middle position between the located letter (of units) and the following one.

6.6 FINAL OPERATIONS

Disconnect the instrument from the calibration circuit.

6.6.1 Weatherproof pressure switches (Model MW)

Take the cover, ensure that the sealing gasket is correctly fitted into its seat, and insert the cover onto the case, with the blocking gap positioned in correspondence to the blocking bracket.

Turn the cover clockwise closing it tightly. Mount the blocking device as in Fig. 4. Mount on pressure connection and cable entry the protection caps supplied with the instrument.

6.6.2 Flameproof pressure switches (Model MA).

Screw on the cover and **block** it using the headless screw with which it is equipped (Fig. 5)

Mount on pressure connection and cable entry the protection caps supplied with the instrument.



Caution: The protection caps should only be definitively removed **during** the connection steps (see § 7).

7 MOUNTING AND CONNECTIONS

7.1 MOUNTING

Surface mount the instrument by means of the holes provided, or **pipe** mount using the appropriate bracket or mount directly on process in a **vertical position** (with the pressure connection downwards) (See fig. 17,18,19,20,21 and 22).

In case of surface or panel or rack mounting the instruments can be mounted side by side (see Fig.19). The chosen position must be such that vibrations, the possibility of shocks or temperature changes are within tolerable limits.

With gas or vapour process fluid, the instrument **must** be positioned higher than the pipe inlet (see Fig. 22). With a liquid process fluid, the instrument can be positioned higher or lower, indifferently (see Fig. 21 and 22).). In this case, during set point calibration the **negative** or **positive head** must be taken into account.




CAUTION: (Instruments MA, MAH, MAG, MW, MWH and MWG) positions other than vertical are allowed provided environmental conditions do not cause condensation to form or water to enter the instrument through the ventilation path (Version MA (*) fig.5). The instruments versions MWB and MAB must be installed in vertical position (process connection towards).

7.2 INSTRUMENT WITH DIAPHRAGM SEALS

When the pressure switch is mounted on diaphragm seal with capillary and the set point is less than 10 bar, the gap (distance h) between diaphragm seal and instrument generates a column of liquid, whose pressure equivalent constitutes a drift of set point. The set point has to be adjusted consequently.

Fig. 7 – Instrument with diaphragm seal

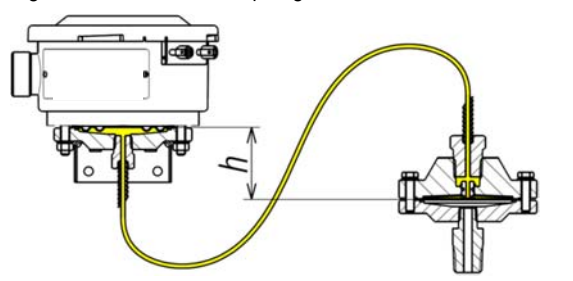

7.3 PRESSURE CONNECTIONS

For a correct installation it is necessary to:


Mount a shut-off valve with drain (root valve) on the process tube to allow the instrument to be excluded and the connection tubing to be drained. It is recommended that said valve has a capstan-blocking device aimed at preventing it being activated casually and without authorisation.

Mount a service valve near the instrument to permit possible functional verification on site. It is recommended that the service valve is closed with a plug to prevent the outlet of the process fluid caused by the incorrect use of said valve.

Mount a three-piece joint into the process connection to permit the easy mounting or removal of the instrument itself.

The pressure connection adaptor have to be installed as per Fig.8

Fig. 8 – Installation of pressure connection adaptor

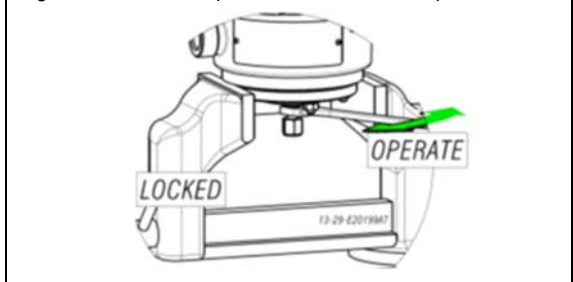

Carry out the connection to the process using a flexible tube in such a way that variations in the temperature of the tube itself do not force the instrument attachment.

Ensure that all the pressure connections are airtight. It is important that there are no leakages in the circuit.


Close the root valve and the relative drain device. Close the service valve using a safety plug.



7.4 INSTRUMENTS WITH PROCESS CONNECTION COATED WITH PTFE

The pressure connection must be made in such a way that the part protruding from the instrument have to be used as a sealing ring.

Fig.9 - Instrument with process connection coated with PTFE

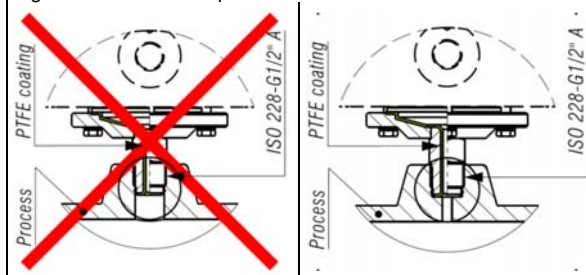

7.5 ELECTRICAL CONNECTIONS

It is recommended to carry out the electrical connections according to the applicable standards.

In case of flameproof instruments and intrinsic safety instruments see also the Standard IEC/EN-60079-14. If the electrical connection is carried out in a protected tube, it shall be made so that condensate is prevented from entering instrument enclosure.


To guarantee the ingress protection IP66 and prevent loosening of the blocking joint or cable glands, it is prescribed to seal the threads with an anaerobic sealant. For example, use a sealant like Loctite ® 542.



CAUTION: fittings used for the electrical connection of the flame-proof instruments shall be certified according the IEC or EN standards and shall guarantee instrument degree of protection (IP66). In the case of Gk threads, this is made in accordance with standard UNI-EN 60079-1 (Italian national variant).

It is recommended the installation according Fig. 21 o 22. The installation of the cable gland or three-piece joint should be as per fig. 10 and 11.

Fig. 10 – Installation of electrical connection

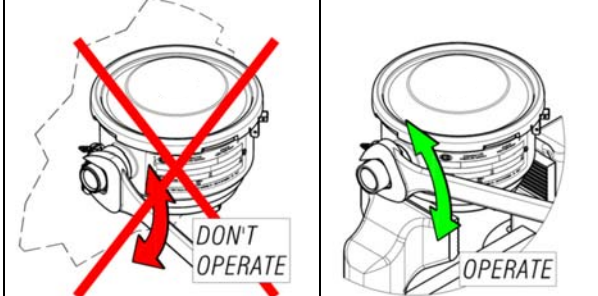

With the instrument into the final position provided that the electric line is not energize, remove the cover and make the electrical connection to the terminal block (see Fig. 2).



If the ambient temperature exceeds 60 °C is recommended to use cables suitable for operating temperatures of at least 105 °C.

Flexible cables with a maximum section of 1,5 mm² (16AWG) are recommended using the pre-insulated crimp ring terminal.


Do not touch the adjustment screws and do not bend the elastic microswitch supports in order to prevent the instrument calibration being altered. Ensure that no deposits or wire ends remain inside the case.



Warning: The instrument may be equipped with one or two micro switches SPDT type. All the electrical connection must be part of intrinsically safe circuits. The relevant parameters for intrinsic safety are listed on the nameplate of the instrument.

The tightening of the cable gland or the three-piece joint must be performed as shown in Fig. 11

Fig. 11 – Installation of the cable gland

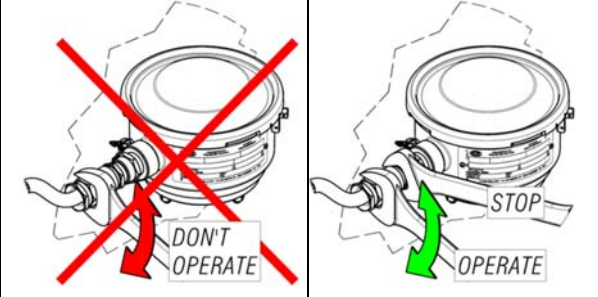


As soon as connection steps are completed, mount the cover on and make sure it is tight and blocked See fig 4 and 5.

7.5.1 CONNETTOR 7 POLES TYPE MIL-5015 FOR WEATHER PROOF INSTRUMENT

The free connector, supplied with the instrument, is able to accept multicore cables with maximum outer diameter 11 mm. It is recommended flexible cables with single-conductor with a maximum section of 1.5 mm² (16AWG).


The cable have to be prepared as per fig. 12

Fig. 12 – Cable preparation

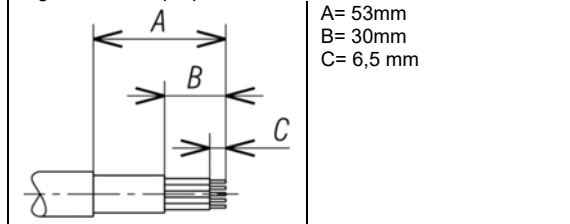

The single stripped conductor has to be crimped with each contact pin. For the electrical connections and for the assembly follow Fig.13.


Fig. 13 – Free connector assembly

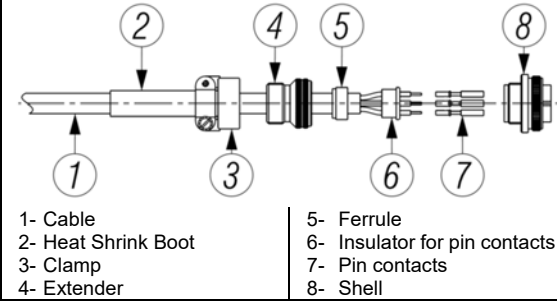

- 1- Cable
- 2- Heat Shrink Boot
- 3- Clamp
- 4- Extender
- 5- Ferrule
- 6- Insulator for pin contacts
- 7- Pin contacts
- 8- Shell

The wiring diagram is according Fig.14.

Fig. 14 – Wiring diagram MIL C-5015

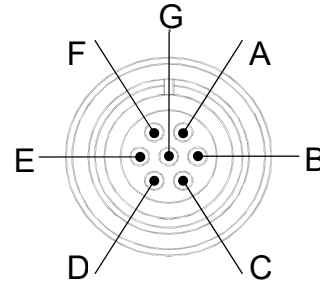

CONTACT	FUNCTION
A	1-NA Micro 1: Normaly open
B	1-NC Micro 1: Normaly closed
C	1-C Micro 1: Common
D	2-NA Micro 2: Normaly open
E	2-NC Micro 2: Normaly closed
F	2-C Micro 2: Common
G	Ground Internal grounding connection

Once the crimping and assembly activities of the free connector are finished, make sure that all the parts are tight. Screw the bayonet and tighten it to assure the instrument degree of protection

7.6 GROUNDING CONNECTIONS

The instrument is supplied with two grounding connections, one external and one internal. The connections are suitable for a earthing wires of 4 mm² section (fig. 2).



8 INSTRUMENT PLUMBING

8.1 Weatherproof pressure switches (Model MW)

The plumbing, aimed as a guarantee against possible tampering of the calibration and electrical connections, can be carried out using a flexible steel wire (c) inserted into the holes in the screw (a) and the bracket (e) provided for this purpose (see Fig. 4).

8.2 Flameproof pressure switches (Model MA)

Plumbing is not necessary as the cover is blocked with a headless screw and the instrument **does not** have to be opened when installed (see Fig. 5).

9 SAFETY INTEGRITY LEVEL (SIL) INSTALLATION REQUIREMENTS

The pressure switch has been evaluated as Type A safety related hardware. It has an hardware fault tolerance of 0 if it is used in one out one configuration (1oo1). The installation has to be designed to allow a proof test to detect dangerous undetected fault using, as example, the following procedure:

- Take appropriate action to avoid a false trip
- Force the switch to reach a define max or min threshold value and verify that output goes into the safe state.
- Force the switch to reach a define normal threshold value and verify that output goes into the normal state.
- Repeat the check two times evaluating average set point value and repeatability,
- Restore the loop to full operation
- Restore normal operation

The installation requirements, the useful life and the failure of the switch is discussed in the Failure Modes, Effects and Diagnostic Analysis Report.

10 PUTTING INTO OPERATION

The instrument comes into operation as soon as is energized and the root valve is opened. Any possible drainage of the connection tubing can be carried out by removing the safety plug and **opening the service valve with the necessary caution.**

Do not dispose of the process fluid into the environment, if this can cause pollution or damage to people

11 VISUAL INSPECTION

Periodically check the external condition of the enclosure. There should be no trace of leakage of process fluid outside the instrument.


In case of flameproof or intrinsic safety instruments, inspections of the electrical installation are to be carried out also according to customer procedures and at least in accordance with Standard EN-60079-17.

The flameproof and the intrinsic safety instruments installed in explosive atmospheres for the combustible dust presence, must be periodically cleaned up externally in order to avoid dust accumulating.

11.1 INSTRUMENT WITH SENSOR TYPE H AND G

The switches equipped with sensing element type H or G are instrument with a piston sensing element. The process connection of such instrument have a hole to check the wear of the O-ring seal. During the visual inspection check the absence of fluid into the position of Fig.15. On the contrary the instrument have to be replaced.


Fig. 15 – Hole to check the wear of the O-ring seal

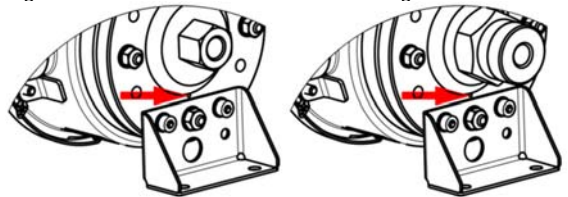

11.2 INSTRUMENTS WITH PROCESS CONNECTION COATED WITH PTFE

These instruments are usually installed on process with high corrosion resistance requirements. To verify the condition of PTFE the process connection is equipped with an inspection hole. During the visual inspection check the absence of fluid into the position of Fig.16. On the contrary the instrument have to be replaced.

Fig. 16 – Hole to check the wear of the PTFE coating

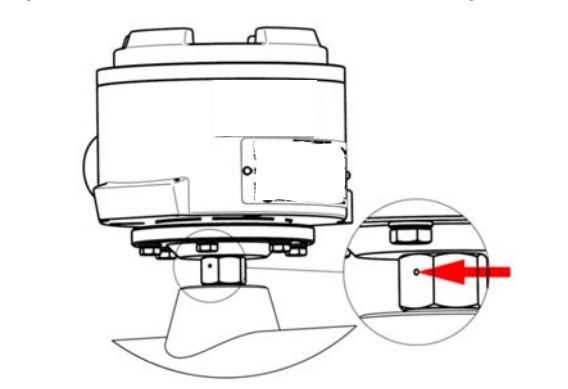

12 FUNCTIONAL VERIFICATION

This will be carried out according to the Customer's control procedures. Model **M** instruments can be verified on the plant if installed as illustrated in Fig. 21 and 22.

To avoid any risk it is recommended check the set point on site without open the cover and without dismount the cable gland and without unplugging the power cable.

The flameproof or intrinsic safety instruments may be checked on site only if the apparatus used are suitable for explosive atmosphere.

If this is not the case it is necessary remove the instrument from the plant, and carry out the verification in a test room.

If the verification of the set point is performed unplugging the power cable from the terminal block it is recommended de-energize the instrument to avoid any electrical hazard.

WARNING: Instrument model MA, flameproof.

Before open the cover or the cable gland check the absence of explosive atmosphere and check that the instrument is **not energized.**

Verification consists in **check the calibration value** and possibly regulating the adjustment bush (see §6).

12.1 INSTRUMENT WITH DIAPHRAGM SEAL OR SENSOR TYPE G

This instrument, because of their particular operating principle, if used as an alarm of max pressure, have to be functional inspected every year as minimum.

13 STOPPING AND DISMOUNTING

Before proceeding with these operations **ensure** that the plant or machines have been put into the **conditions** foreseen to allow these operations.

With reference to Figures 21 e 22

Remove the power supply (signal) from the electrical line. Close the root valve (6) and open the drain. Remove the plug (2), open the valve (3) and wait until the process fluid has drained from the tubing through the drain.

Do not dispose of the process fluid into the environment, if this can cause pollution or damage to people.

Unscrew the three-piece joint (8).

WARNING: Instrument model MA, flameproof.

Before open the cover or the cable gland check the absence of explosive atmosphere and check that the instrument is not energized.

Unscrew the three-piece joint (10) (electrical cable tubing).

Remove the instrument cover and disconnect the electrical cables from the terminal block and earth screws.

Remove the screws fixing the case to the panel (or pipe) and remove the instrument, taking care to slide the electrical conductors out from the case.

Mount instrument cover. Insulate and protect cables around, if any. Temporarily plug pipes not connected to the instrument.

In case of flameproof instruments or intrinsic safety it is recommended to follow - at least - the standard EN-60079-17 for the withdrawal from service of electrical apparatus.

14 DISPOSAL

The instruments are mainly made of stainless steel and aluminium and therefore, once the electrical parts have been dismantled and the parts coming into contact with fluids which could be harmful to people or the environment have been properly dealt with, they can be scrapped.



15 TROUBLESHOOTING



IMPORTANT NOTE: operations involving replacement of essential components must be carried out at our workshop, especially for instruments with flameproof certificate; this is to guarantee the user the total and correct restoration of the product original characteristics.



MALFUNCTION	PROBABLE CAUSE	REMEDY
Set point shift	<ul style="list-style-type: none"> ■ Permanent deformation of the sensitive element due to fatigue or non-tolerated overages. ■ Variation of the elastic features of the sensitive element due to its chemical corrosion. ■ O-ring wear (only MWH and MAH) 	<ul style="list-style-type: none"> ■ Recalibrate or replace the sensitive element. ■ Recalibrate or replace the sensitive element with another made of a suitable material. If necessary apply a fluid separator. ■ Replace the piston subgroup and recalibrate.
Poor repeatability	<ul style="list-style-type: none"> ■ O-ring wear (only MWH and MAH) ■ Air bubbles or condensation (only for types with pressure <1 bar). 	<ul style="list-style-type: none"> ■ Replace the piston subgroup and recalibrate. ■ Drain the process connection line and if necessary modify it.
Slow response	<ul style="list-style-type: none"> ■ Clogged or obstructed connection line. ■ Root valve partially closed. ■ Too viscous fluid. 	<ul style="list-style-type: none"> ■ Check and clean line. ■ Open valve. ■ Provide instrument with suitable fluid separator.
No actuation or undue actuation	<ul style="list-style-type: none"> ■ Root valve closed. ■ Microswitch contacts damaged. ■ Loosened electrical joints. ■ Interrupted or short-circuited electrical line. 	<ul style="list-style-type: none"> ■ Open the valve. ■ Replace the Microswitch. ■ Check all electrical joints. ■ Check the conditions of the electrical line.
Undue actuation	<ul style="list-style-type: none"> ■ Accidental shocks or excessive mechanical vibrations. 	<ul style="list-style-type: none"> ■ Modify the mounting.

Fig. 17 – Mounting of the brackets for 2" pipe and possible position

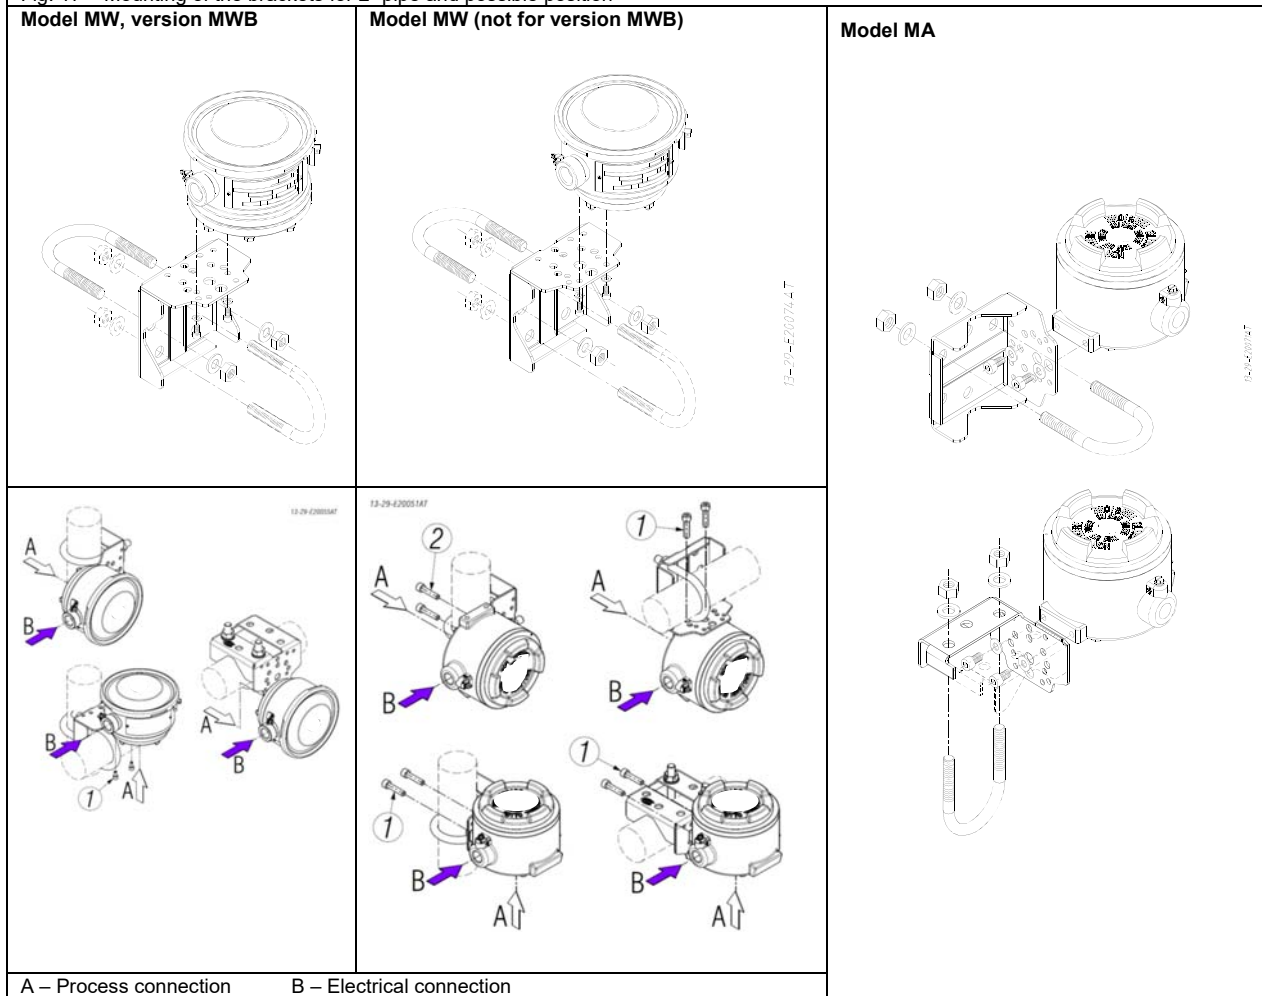


Fig. 18 – Wall mounting

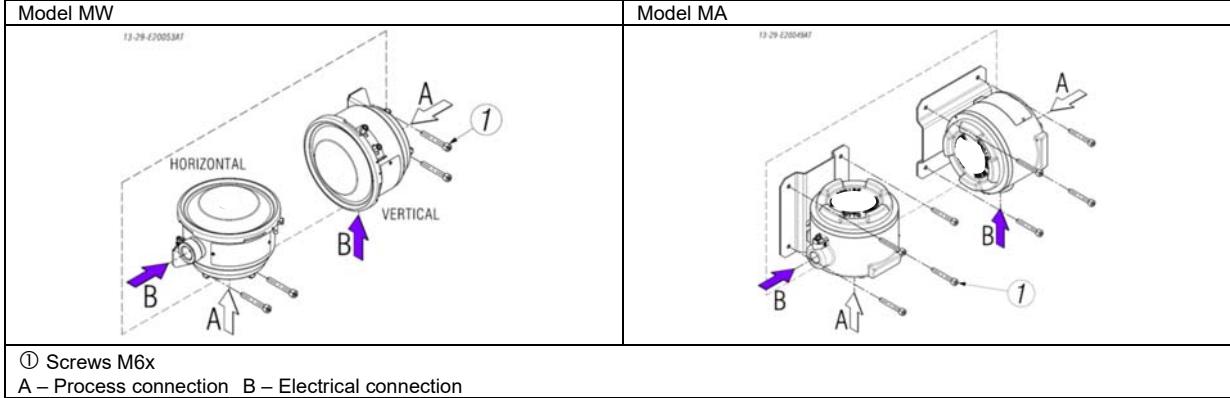


Fig. 19 – Rack mounting

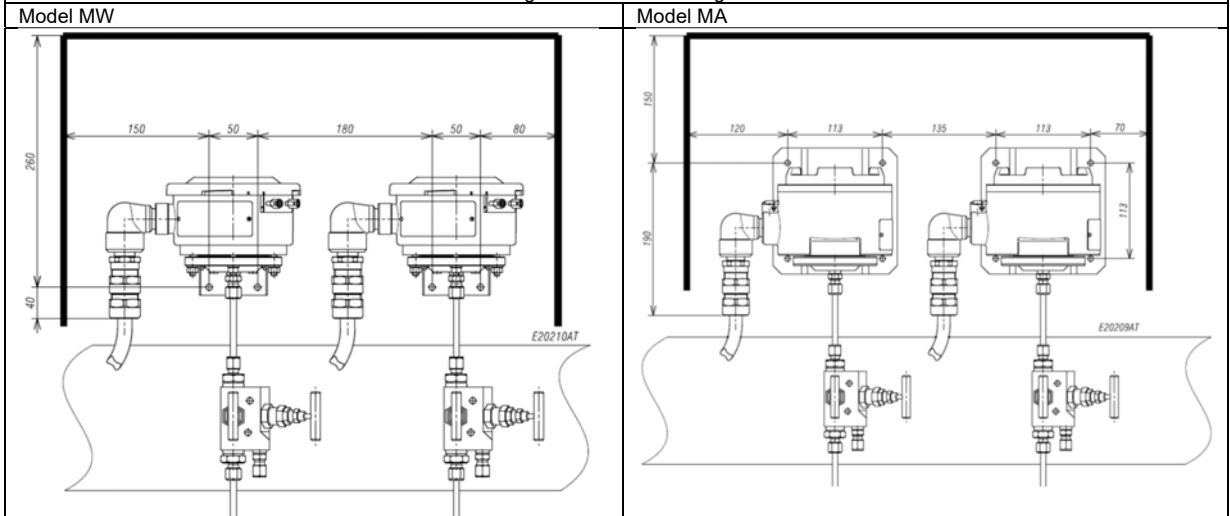


Fig. 20 – Direct mounting

